


Typical Residential Solar / Wind Installation

Note: Installation must be in compliance with the NEC

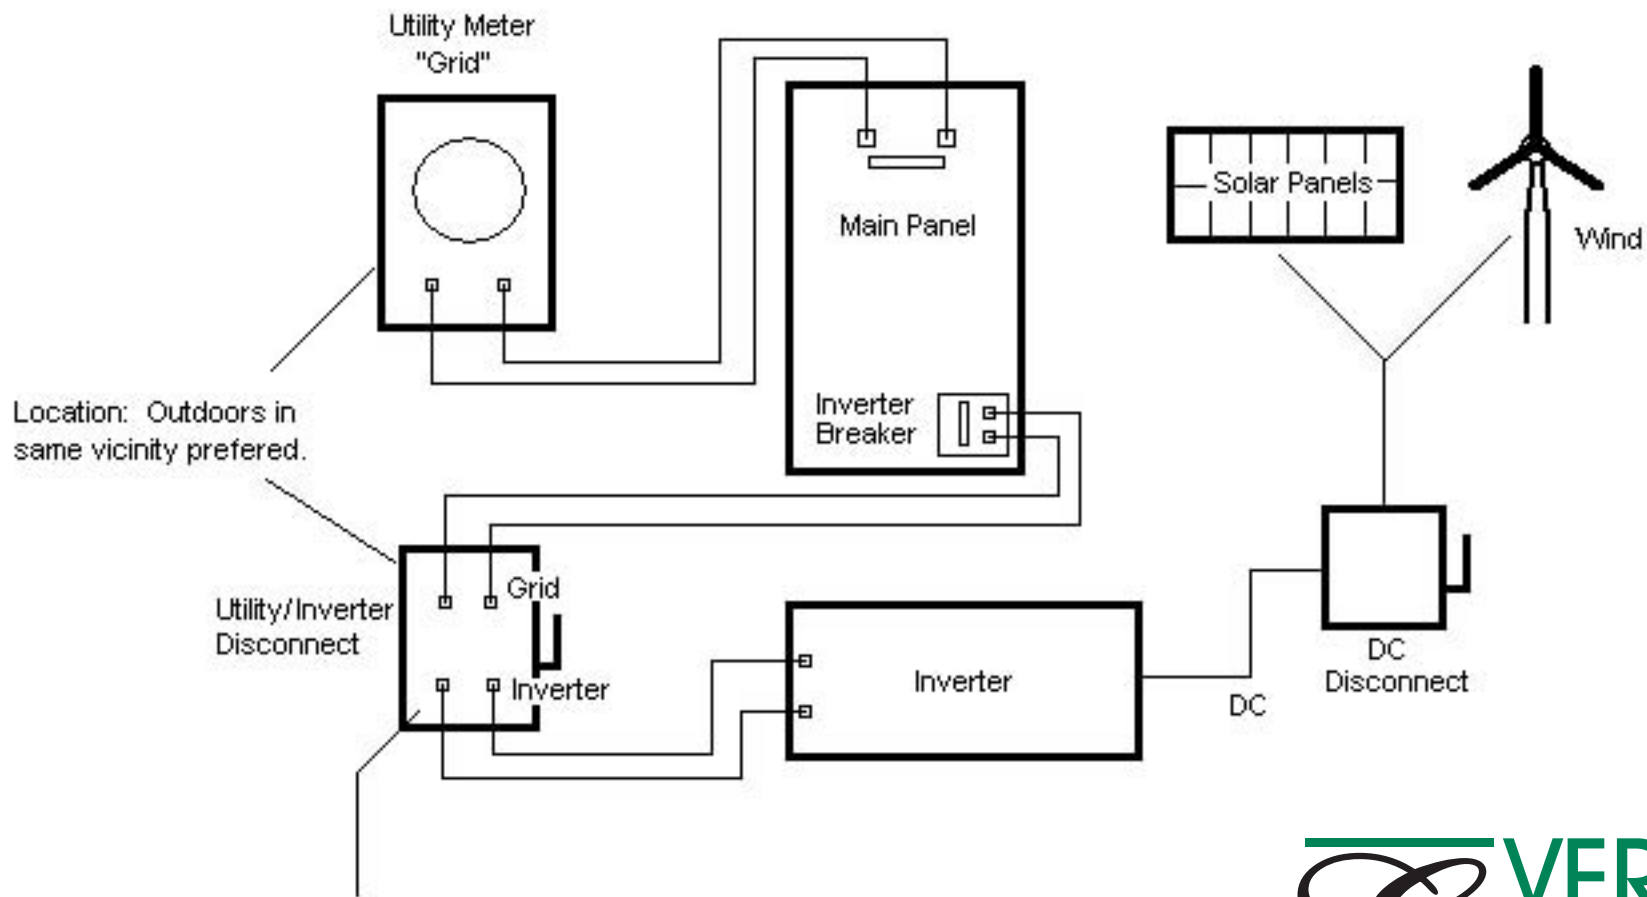

Location: Outdoors in same vicinity preferred.

Utility/Inverter Disconnect

NOTE: Top lugs of disconnect are connected to the electric service. Bottom lugs are connected to inverter. Disconnect must be labeled as such.



Your Touchstone Energy® Cooperative 